


PLAN VIEW

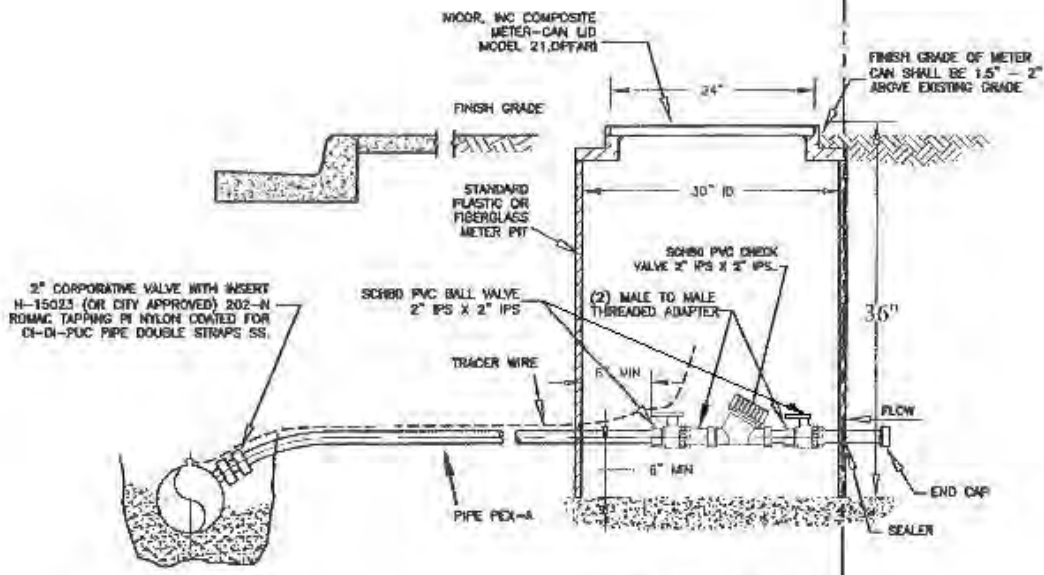

SECTION VIEW

**NOTE:**

1. CONTRACTOR SHALL REMOVE END CAP AND CONNECT TO EXISTING 2" CAP.
2. CONTRACTOR SHALL BORE A HOLE INTO EXISTING BOX TO RUN PIPE THROUGH AND PROVIDE SEALER TO PREVENT WATER SEEPAGE.
3. CENTRIFUGAL PUMP OR APPROVED EQUAL RECOMMENDED FOR THIS APPLICATION.
4. TEE IS REQUIRED TO SEPARATE SERVICES SHALL BE CAPED ON OTHER IF NO OTHER SERVICE.
5. UPON DEVELOPMENT, THE OWNER SHALL INSTALL A PRIVATE BALL/CHECK VALVE WITH CAN AS SHOWN ABOVE



City of Aztec  
Public Works  
Department

## 2" PRESSURE SANITARY SEWER LATERAL DETAIL

### CONSTRUCTION STANDARDS

STANDARD NO. SS-18-2

SHEET 2 OF 2

APP'D R. Salcido  
DATE Oct. 11, 2023