



City of Aztec
Public Works
Department


WATER SERVICE CONNECTION 1-1/2" METER

CONSTRUCTION STANDARDS

STANDARD NO. W-12

SHEET 1 OF 1

APP'D R. Salcido
DATE Oct. 11, 2023

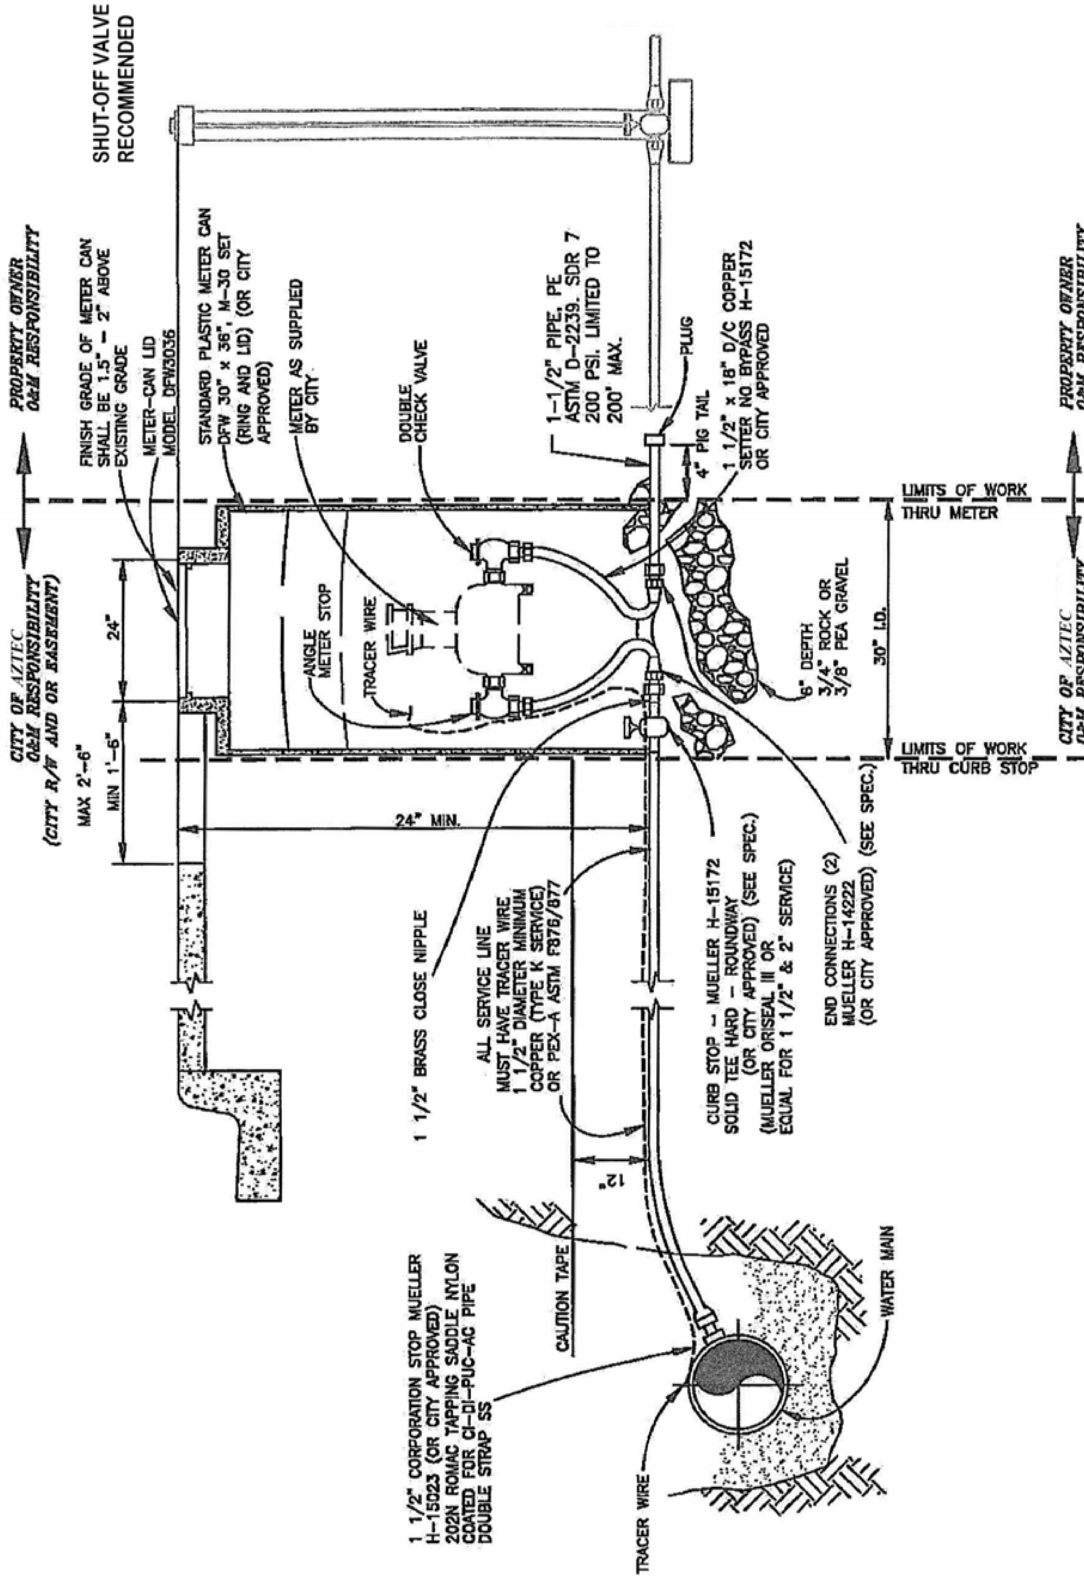

NOTES:

1. UNLESS OTHERWISE APPROVED BY THE CITY, ALL SERVICE LINES TAPPED INTO EXISTING WATER MAINS ARE TO BE INSTALLED BY AN APPROVED LICENSED CONTRACTOR FOR 1-1/2" AND SMALLER METER SERVICES.
2. FOR COMMERCIAL PROPERTIES WITH ZERO LOT LINE PLACE METER ONE FOOT BEHIND CURB.
3. WHENEVER POSSIBLE, ALL METERS SHALL BE INSTALLED WITHIN THE RIGHT-OF-WAY BEHIND SIDEWALK, OUTSIDE OF DRIVEWAY AREA AND CLOSE TO PROPERTY LINE.
4. TAMPERING AND ACCESS OF THE METER CAN IS PROHIBITED. FOR ACCESS INTO METER CAN CONTACT THE CITY'S PUBLIC WORKS DEPT.
5. SHOULD THE CITY DEEM USE OF THE PROPERTY AS HIGH HAZARD, THEN AN RP BACKFLOW IN ADDITION TO THE DOUBLE CHECK VALVE WILL BE REQUIRED.
6. THE PROPERTY OWNER SHOULD INSTALL A SIMILAR SHUT OFF VALVE AS INDICATED AT THE TIME OF METER INSTALLATION AS SHOWN.
7. FOR WATER METER CANS, PROVIDE NO MORE THAN 4" "PIG-TAIL" SERVICE LINE STUB OUT OUTSIDE OF METER CAN (CUSTOMER SIDE). "PIG-TAIL" SHALL BE WRAPPED TO PREVENT DAMAGE.
8. WITHIN NMDOT RIGHT-OF-WAY AREAS ONLY, ALL NEW WATER SERVICE LINES SHALL MAINTAIN A MINIMUM OF 36" DEPTH FROM FINAL GRADE.