

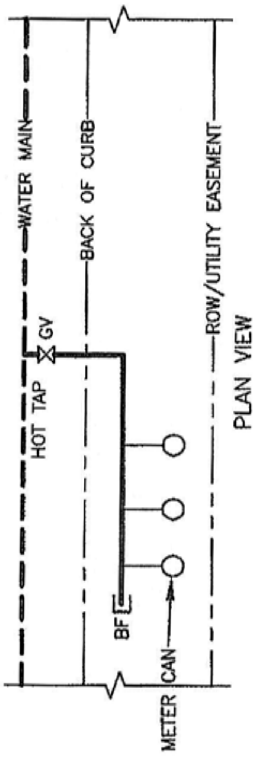
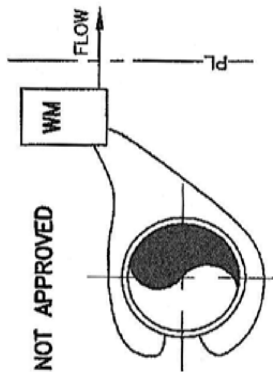


MANIFOLD SHALL BE
4" OR 6" C-900 (PVC) PIPE ONLY
SEE CHART BELOW


ALT. 1

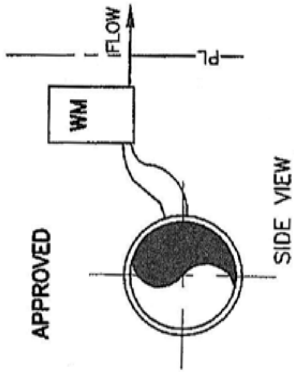

ALT. 2

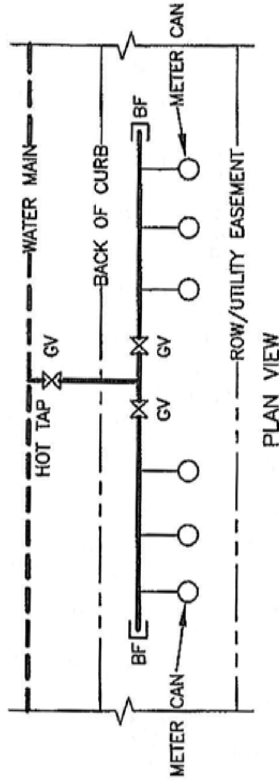


1" CORPORATION STOP MUELLER
H-15028 (OR EQUAL) (SEE SPEC.)
DOUBLE STRAP, SS
SERVICE

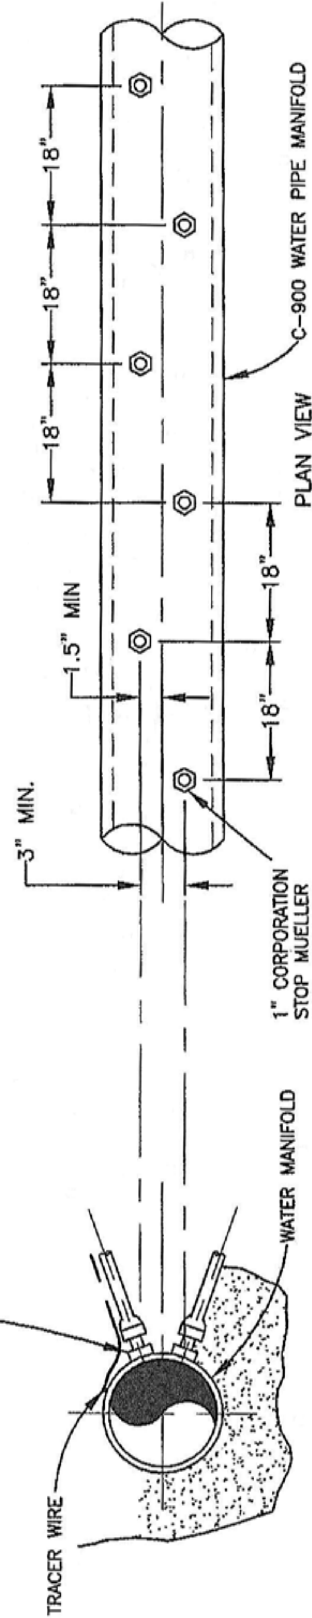

NOTES:

1. MANIFOLD MUST BE TAPPED ON METER (PRIVATE PROPERTY) SIDE ONLY.
2. MANIFOLD SHALL BE INSTALLED OUTSIDE THE SIDEWALK AND DRIVEWAY AREAS.

PIPE SIZES VS # OF METERS		
MANIFOLD SIZE	5/8" METER	1" METER
4"	2-10	2-6
6"	11+	7+



**WATER SERVICE
MANIFOLD DETAIL**

CONSTRUCTION STANDARDS

STANDARD NO. W-18

SHEET 1 OF 1

APP'D R. Salcido
DATE Oct. 11, 2023