



SET BASE ON SOLID  
CONCRETE BLOCK AFTER  
BACKFILLING PIPE

PLAN

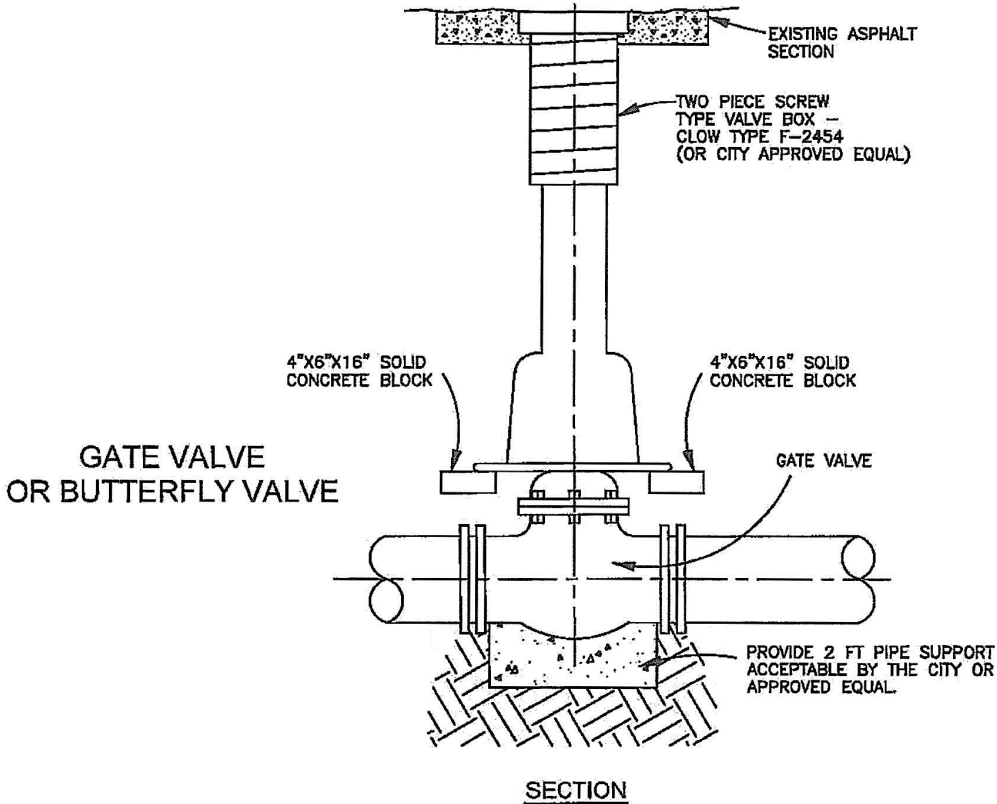

SECTION

- NOTE:**
- MEG-A-LUG WEDGE ACTION JOIST RESTRAINT, SERIES - 1100 FOR CAST IRON OR DUCTILE, SERIES - 1100 PV FOR CAST IRON SIZE PVC (TYPICAL).
  - PRE-MIXED CONCRETE BAGS MAY BE USED WITH CITY ENGINEER APPROVAL.



**VALVE INSTALLATION  
FOR ASPHALT PAVING AREAS**

---

**CONSTRUCTION STANDARDS**

**STANDARD NO. W-3**

**SHEET 1 OF 2**

APP'D R. Salcido  
DATE Oct. 11, 2023