


SET BASE ON SOLID
CONCRETE BLOCK AFTER
BACKFILLING PIPE


PLAN

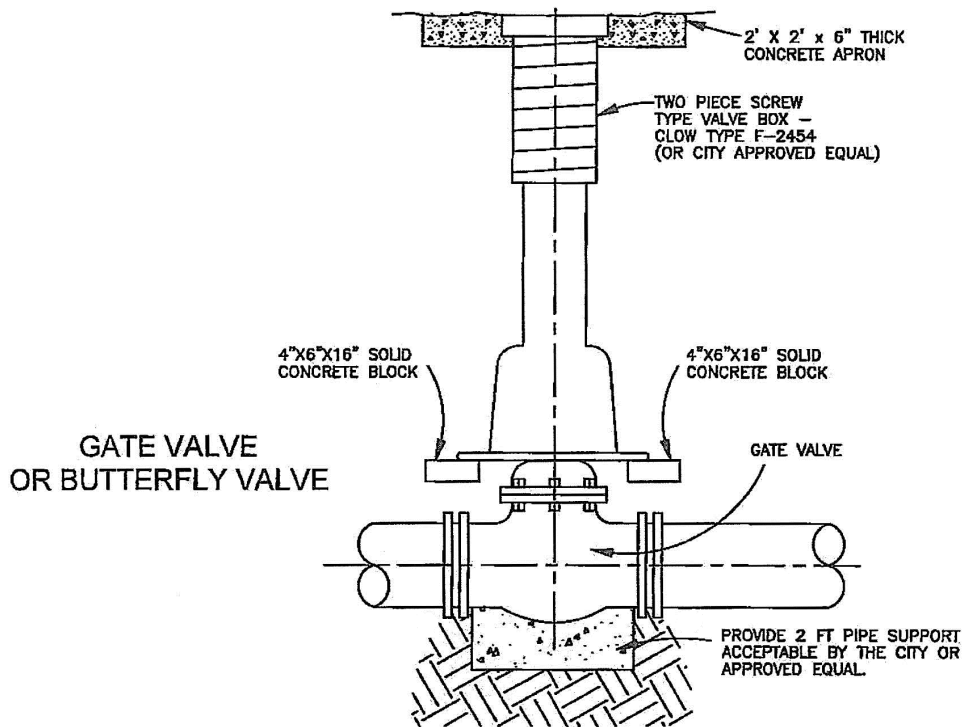

SECTION

NOTE:

1. MEG-A-LUG WEDGE ACTION JOIST RESTRAINT, SERIES - 1100 FOR CAST IRON OR DUCTILE, SERIES - 1100 PV FOR CAST IRON SIZE PVC (TYPICAL).
2. PRE-MIXED CONCRETE BAGS MAY BE USED WITH CITY ENGINEER APPROVAL.



**VALVE INSTALLATION
FOR NON PAVEMENT AREAS**

STANDARD NO. W-3

SHEET 2 OF 2

CONSTRUCTION STANDARDS

APP'D R. Salcido
DATE Oct. 11, 2023