



NOTE

MINIMUM DEPTH OF COVER OVER WATER LINE - 42"

6" FLEXIBLE 180° ELBOW ABOVE GROUND PIPING PAINTED PER A.W.W.A. C204.

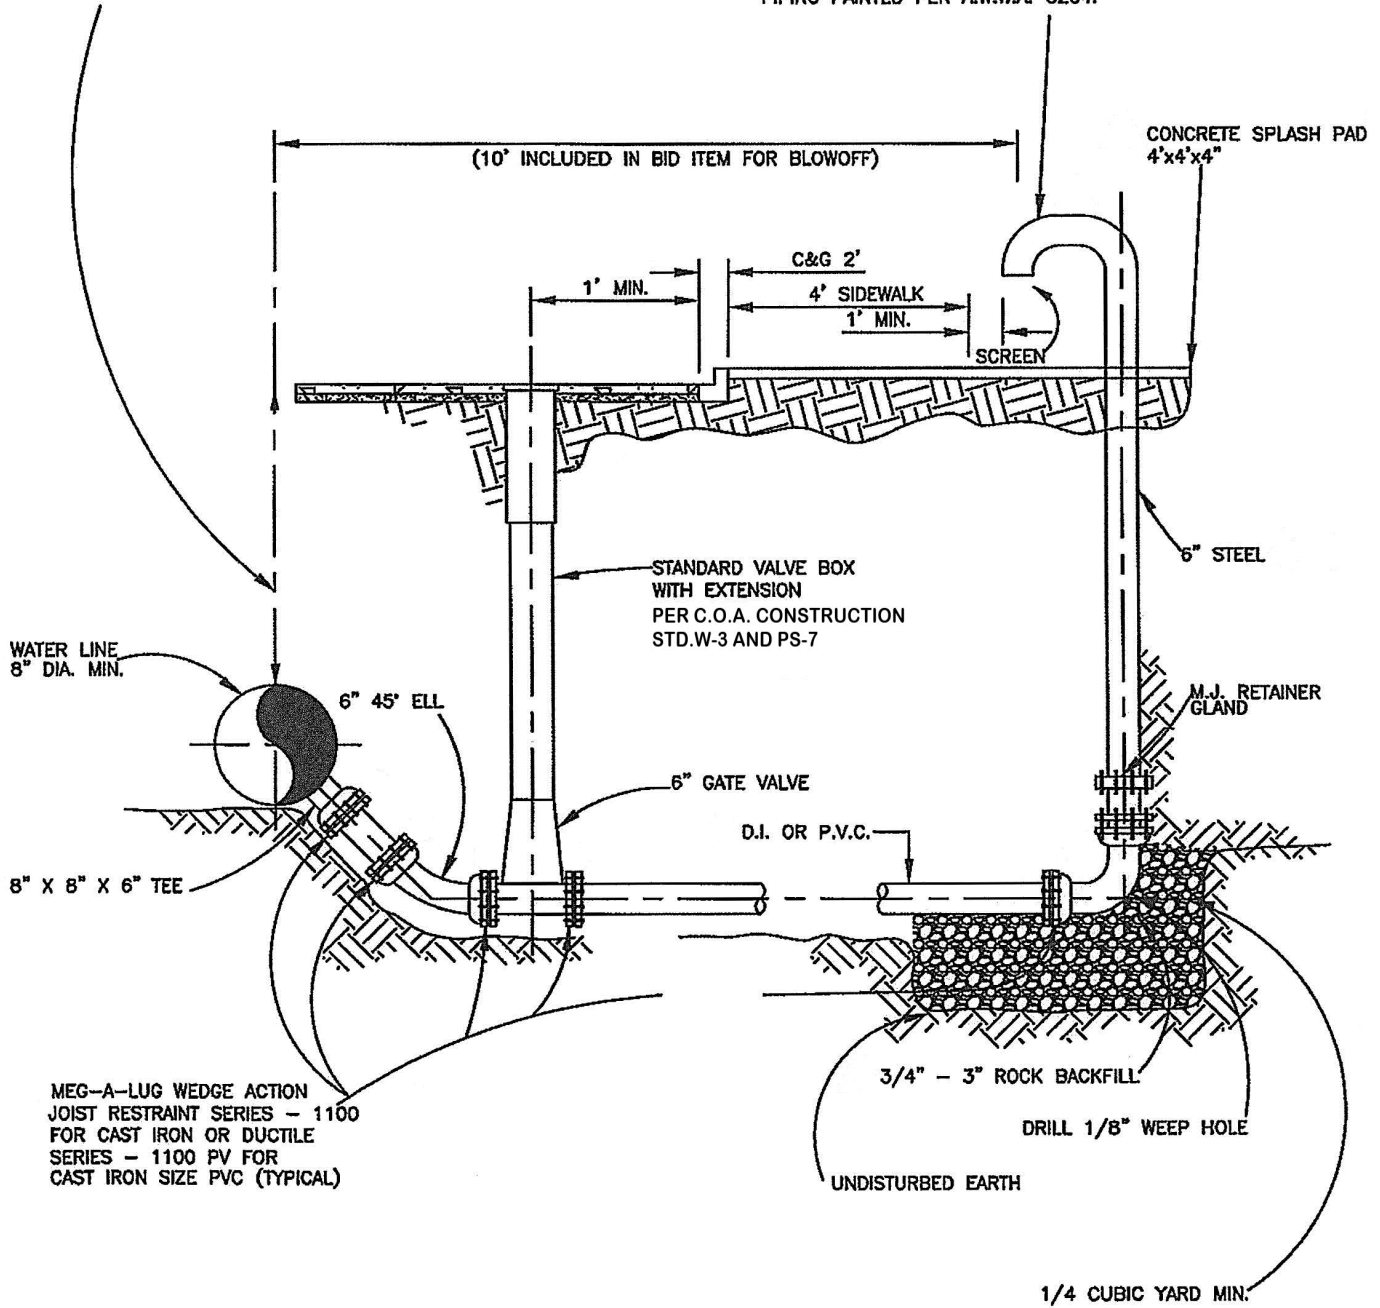

MEG-A-LUG WEDGE ACTION JOIST RESTRAINT SERIES - 1100 FOR CAST IRON OR DUCTILE SERIES - 1100 PV FOR CAST IRON SIZE PVC (TYPICAL)



BLOW-OFF VALVE ASSEMBLY DETAIL

CONSTRUCTION STANDARDS

STANDARD NO. W-5

SHEET 1 OF 1

APP'D R. Salcido

DATE Oct. 11, 2023