


STANDARD HYDRANT TOP VIEW

NOTE:

1. PROVIDE 45" RADIUS AND 7 FT OVERHEAD "CLEAR-AREA" AROUND FIRE HYDRANT EXCEPT HYDRANT WITH BOLLARDS.
2. NO CURBING AROUND HYDRANT UNLESS AUTHORIZED BY CITY.
3. 45" RADIUS "CLEAR-AREA" SHALL BE FLUSH WITH CONCRETE PAD.

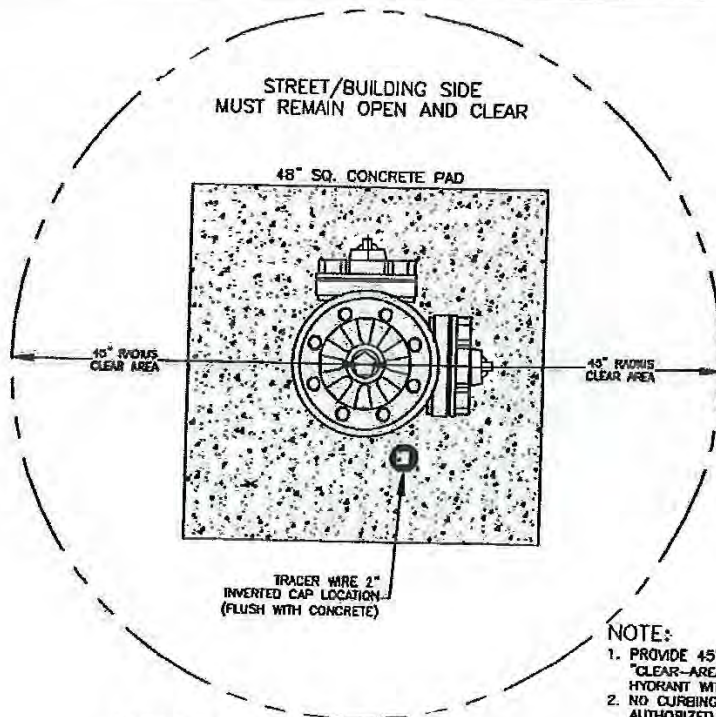

DOUBLE STEAMER TOP VIEW

NOTE:

1. PROVIDE 45" RADIUS AND 7 FT OVERHEAD "CLEAR-AREA" AROUND FIRE HYDRANT EXCEPT HYDRANT WITH BOLLARDS.
2. NO CURBING AROUND HYDRANT UNLESS AUTHORIZED BY CITY.
3. 45" RADIUS "CLEAR-AREA" SHALL BE FLUSH WITH CONCRETE PAD.



**FIRE HYDRANT (TOP VIEW)
WITHOUT BOLLARD**

CONSTRUCTION STANDARDS

STANDARD NO. W-6

SHEET 5 OF 7

APP'D R. Salcido
DATE Oct. 11, 2023